CODE STUDY

- 2021 NEW HAMPSHIRE BUILDING CODE (IBC)
- 2021 NEW HAMPSHIRE EXISTING BUILDING CODE (IEBC)
- 2018 NEW HAMPSHIRE ENERGY CONSERVATION CODE (IECC)
- 2021 NEW HAMPSHIRE MECHANICAL CODE (IMC)
- 2021 NEW HAMPSHIRE PLUMBING CODE (IPC)
- 2023 NEW HAMPSHIRE ELECTRICAL CODE
- 2021 NEW HAMPSHIRE LIFE SAFETY CODE, NFPA 101
- 2021 UNIFORM FIRE CODE, NFPA 1
- 2010 ADA STANDARDS
- 2021 NEW HAMPSHIRE ACCESSIBILITY CODE

ALTERATIONS
IECC: LEVEL 3
NFPA 101: LEVEL 2
IBC: I-4 (INFANTS)
IBC: E (2.5 YEARS AND OLDER)
NFPA: DAYCARE

OCCUPANCY 302
OCCUPANCY CLASSIFICATION: E AND I-4

506.2

LOWER FLOOR	3,621 SF
FIRST FLOOR	6,281 SF
UPPER FLOOR	2,721 SF
TOTAL AREA	12,623 SF

MAXIMUM ALLOWABLE AREA: 27,000 SF

601
FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: 0 HR

602
CONSTRUCTION TYPE; V-B
NFPA 101: V

903.2.3
EXISTING PROJECT: 100% SPRINKLERED
RENOVATION: 100% SPRINKLER
EXISTING PROJECT: 100% FIRE ALARM
RENOVATION: 100% FIRE ALARM

1004.5

OCCUPANT LOAD LOWER FLOOR	39
OCCUPANT LOAD FIRST FLOOR	191
OCCUPANT LOAD SECOND FLOOR	34
TOTAL OCCUPANT LOAD	110

1006.2.1
LOWER FLOOR: 1 EXIT REQUIRED, 2 PROVIDED
FIRST FLOOR: 2 EXITS REQUIRED, 3 EXITS PROVIDED
SECOND FLOOR: 1 EXIT REQUIRED, 1 PROVIDED

1007.1.1, EXCEPTION 2.
EXITS SEPARATED BY NOT LESS THAN 1/3 DIAGONAL DISTANCE

1017.2
EXIT ACCESS TRAVEL DISTANCE: 200'

1020.2
CORRIDOR FIRE-RESISTANCE RATING: 0 HR

1020.3
MINIMUM CORRIDOR WIDTH 44"
CORRIDOR WIDTH PROVIDED 44"


DESIGN BUILD DESIGN
MECHANICAL
ELECTRICAL
PLUMBING
FIRE PROTECTION

FEC = FIRE EXTINGUISHER AND CABINET
FE = FIRE EXTINGUISHER

DAYCARE

RENOVATION

235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

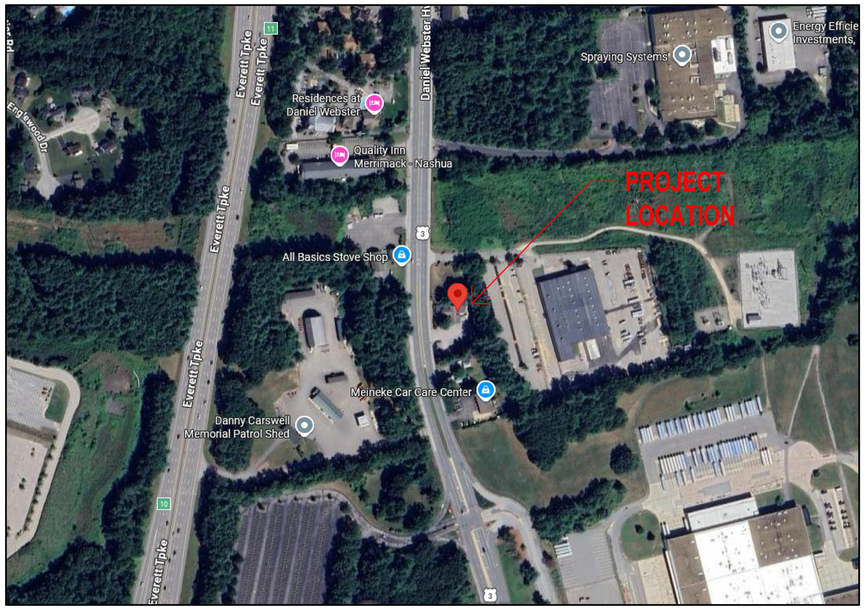



PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
(603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: 781-779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

OWNER
TRIPLE CONSTRUCTION
CONTACT: JENNIFER POLES
237 DANIEL WEBSTER HIGHWAY
MERRIMACK, NH 03054
546-1082 EXT. 503
JPOLES@TRIPLE-CONSTRUCTION.COM

TENANT
NATURES WAY
33 BABOOSIC LAKE ROAD
MERRIMACK, NH 03054
(603) 423-0267

TABLE OF CONTENTS

GENERAL

T1.0	TITLE SHEET
DC1.0	CODE STUDY LOWER FLOOR PLAN
DC1.1	CODE STUDY FIRST FLOOR PLAN
DC1.2	CODE STUDY UPPER FLOOR PLAN

ARCHITECTURAL

A1.0	LOWER FLOOR PLAN
A1.1	FIRST FLOOR PLAN
A1.2	UPPER FLOOR PLAN
A9.0	SCHEDULES

NARRATIVE

FIT-OUT OF THE EXISTING 12,600SF WOOD-FRAME BUILDING TO A CHILD DAY CARE CENTER IN ACCORDANCE WITH CODE AND WITH RSA 170-E/NH DEPARTMENT OF HEALTH AND HUMAN SERVICES (DHHS) HE-C 4002. SEE CODE STUDY FOR MORE COMPLIANCE INFORMATION. A COMPLIANT OCCUPANCY COUNT HAS BEEN ESTABLISHED AND IS OUTLINED ON DRAWINGS, PER SPACE.

ITEMS BY OWNER

- KITCHEN EQUIPMENT

GENERAL NOTES

1. CONTRACTOR TO ENSURE ALL CONSTRUCTION MATERIALS & METHODS MEET OR EXCEED ALL LOCAL CODE REQUIREMENTS.
2. NEW DIMENSIONS ARE FROM FACE OF STUD OR TO CENTER LINE OF OPENING, UNLESS OTHERWISE NOTED. EXISTING DIMENSIONS ARE FROM FACE OF STRUCTURE, PANEL, OR SHEATHING TO SAME. VERIFY ANY DISCREPANCIES IN FIELD AND REPORT TO ARCHITECT PRIOR TO CONSTRUCTION.
3. ALL DIMENSIONS SHALL BE VERIFIED AT THE JOB BY THE GENERAL CONTRACTOR AND EACH SUB CONTRACTOR, AND THE ARCHITECT SHALL BE NOTIFIED OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK.
4. THE GENERAL CONTRACTOR SHALL SURVEY THE FIELD CONDITIONS AND INSPECT THE PREMISES AND BECOME FAMILIAR WITH THE BUILDING, THE VARIOUS EXISTING MATERIALS, ASSEMBLIES, AND COMPONENTS OF THE WORK. VERIFY ALL DETAILS AND DIMENSIONS BEFORE PROCEEDING WITH WORK. SUBMIT ALL QUESTIONS TO THE ARCHITECT IN WRITING PRIOR TO START.
5. PROVIDE TEMPORARY BRACING & SHORING AS NECESSARY TO MAINTAIN THE BUILDING SHELL IN A SAFE CONDITION DURING EVERY ASPECT OF THE PROJECT.
6. PROVIDE ALL TEMPORARY WEATHER PROTECTION AS REQUIRED TO MAINTAIN THE BUILDING IN HABITABLE AND DRY CONDITION THROUGHOUT THE CONSTRUCTION PERIOD.
7. ALL WORKMANSHIP AND MATERIALS SHALL CONFORM TO ALL APPLICABLE CODES AND REGULATIONS.
8. GC TO PROVIDE ALL MATERIAL SAFETY DATA SHEETS (MSDS) INFORMATION FOR ALL PRODUCTS USED.
9. THE ARCHITECT'S RESPONSIBILITY IS LIMITED TO THE ITEMS SHOWN ON THE ARCHITECTURAL DRAWINGS, AND ANY WORK DEVIATING FROM THESE DRAWINGS SHALL BE APPROVED BY THE ARCHITECT PRIOR THAT WORK'S COMMENCEMENT. IT IS THE CONTRACTORS RESPONSIBILITY TO COMPLY WITH STANDARD BUILDING AND CONSTRUCTION PRACTICES AND/OR WITH MANUFACTURER'S RECOMMENDATIONS FOR ALL ITEMS NOT SPECIFICALLY INDICATED AND DETAILED ON THE DRAWINGS.
10. COORDINATE LOCATIONS AND/OR ELEVATIONS OF FLOOR DRAINS, REGISTERS, ACCESS PANELS, GRILLES, LOUVERS, CABINET UNIT HEATERS, ELECTRICAL PANELS, ETC. WITH THE MECHANICAL, ELECTRICAL, PLUMBING OR FIRE PROTECTION/ FIRE ALARM CONTRACTOR.
11. ALL EQUIPMENT FURNISHED AND WORK COMPLETED UNDER THE CONTRACT DOCUMENTS SHALL BE GUARANTEED AGAINST DEFECT IN BOTH WORKMANSHIP AND MATERIALS FOR A PERIOD OF ONE (1) YEAR STARTING AT THE DATE OF FINAL ACCEPTANCE. ANY FAILURE DUE TO WORKMANSHIP AND/OR MATERIALS WITHIN THIS ONE (1) YEAR PERIOD SHALL BE CORRECTED BY THE CONTRACTOR AT NO COST TO THE OWNER.
12. OWNER IS RESPONSIBLE FOR ANY HAZARDOUS MATERIAL TESTING INSIDE OF WORK AREA.
13. CONTRACTOR IS RESPONSIBLE FOR FULLY REVIEWING THE CONSTRUCTION DOCUMENTS AND NOTIFYING THE ARCHITECT OF ANY QUESTIONS ARISING FROM ANY DISCREPANCIES PRIOR TO WORK/MATERIAL PROCUREMENT.
14. CONTRACTOR TO PROVIDE A LIST OF SUBMITTALS FOR ARCHITECT'S REVIEW AND APPROVAL. ALL SUBMITTALS WILL BE PROVIDED IN A TIMELY FASHION, AS AGREED PRIOR TO START.
15. CONTRACTOR TO PROVIDE A SCHEDULE FOR THE WORK PRIOR TO START FOR REVIEW AND APPROVAL BY ARCHITECT AND OWNER.

ACS
RESIDENTIAL • COMMERCIAL • INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R MASON No. 3380
THE STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED. ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

T1.0

TITLE SHEET

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

CODE STUDY:

- 2021 NEW HAMPSHIRE BUILDING CODE (IBC)
- 2021 NEW HAMPSHIRE EXISTING BUILDING CODE (IEBC)
- 2018 NEW HAMPSHIRE ENERGY CONSERVATION CODE (IECC)
- 2021 NEW HAMPSHIRE MECHANICAL CODE (IMC)
- 2021 NEW HAMPSHIRE PLUMBING CODE (IPC)
- 2023 NEW HAMPSHIRE ELECTRICAL CODE
- 2021 NEW HAMPSHIRE LIFE SAFETY CODE, NFPA 101
- 2021 UNIFORM FIRE CODE, NFPA 1
- 2010 ADA STANDARDS
- 2021 NEW HAMPSHIRE ACCESSIBILITY CODE

ALTERATIONS
IECC: LEVEL 3
NFPA 101: LEVEL 2
IBC: I-4 (INFANTS)
IBC: E (2.5 YEARS AND OLDER)
NFPA: DAYCARE

OCCUPANCY 302
OCCUPANCY CLASSIFICATION: E AND I-4

506.2

LOWER FLOOR	3,621 SF
FIRST FLOOR	6,281 SF
UPPER FLOOR	2,721 SF
TOTAL AREA	12,623 SF

MAXIMUM ALLOWABLE AREA: 27,000 SF

601
FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: 0 HR

602
CONSTRUCTION TYPE: V-B
NFPA 101: V

903.2.3
EXISTING PROJECT: 100% SPRINKLERED
RENOVATION: 100% SPRINKLER
EXISTING PROJECT: 100% FIRE ALARM
RENOVATION: 100% FIRE ALARM

1004.5

OCCUPANT LOAD LOWER FLOOR	39
OCCUPANT LOAD FIRST FLOOR	191
OCCUPANT LOAD SECOND FLOOR	34
TOTAL OCCUPANT LOAD	110

1006.2.1
LOWER FLOOR: 1 EXIT REQUIRED, 2 PROVIDED
FIRST FLOOR: 2 EXITS REQUIRED, 3 EXITS PROVIDED
SECOND FLOOR: 1 EXIT REQUIRED, 1 PROVIDED

1007.1.1, EXCEPTION 2.
EXITS SEPARATED BY NOT LESS THAN 1/3 DIAGONAL DISTANCE


1017.2
EXIT ACCESS TRAVEL DISTANCE: 200'

1020.2
CORRIDOR FIRE-RESISTANCE RATING: 0 HR

1020.3
MINIMUM CORRIDOR WIDTH 44"
CORRIDOR WIDTH PROVIDED 44"

DESIGN BUILD DESIGN
MECHANICAL
ELECTRICAL
PLUMBING
FIRE PROTECTION

FEC = FIRE EXTINGUISHER AND CABINET
FE = FIRE EXTINGUISHER

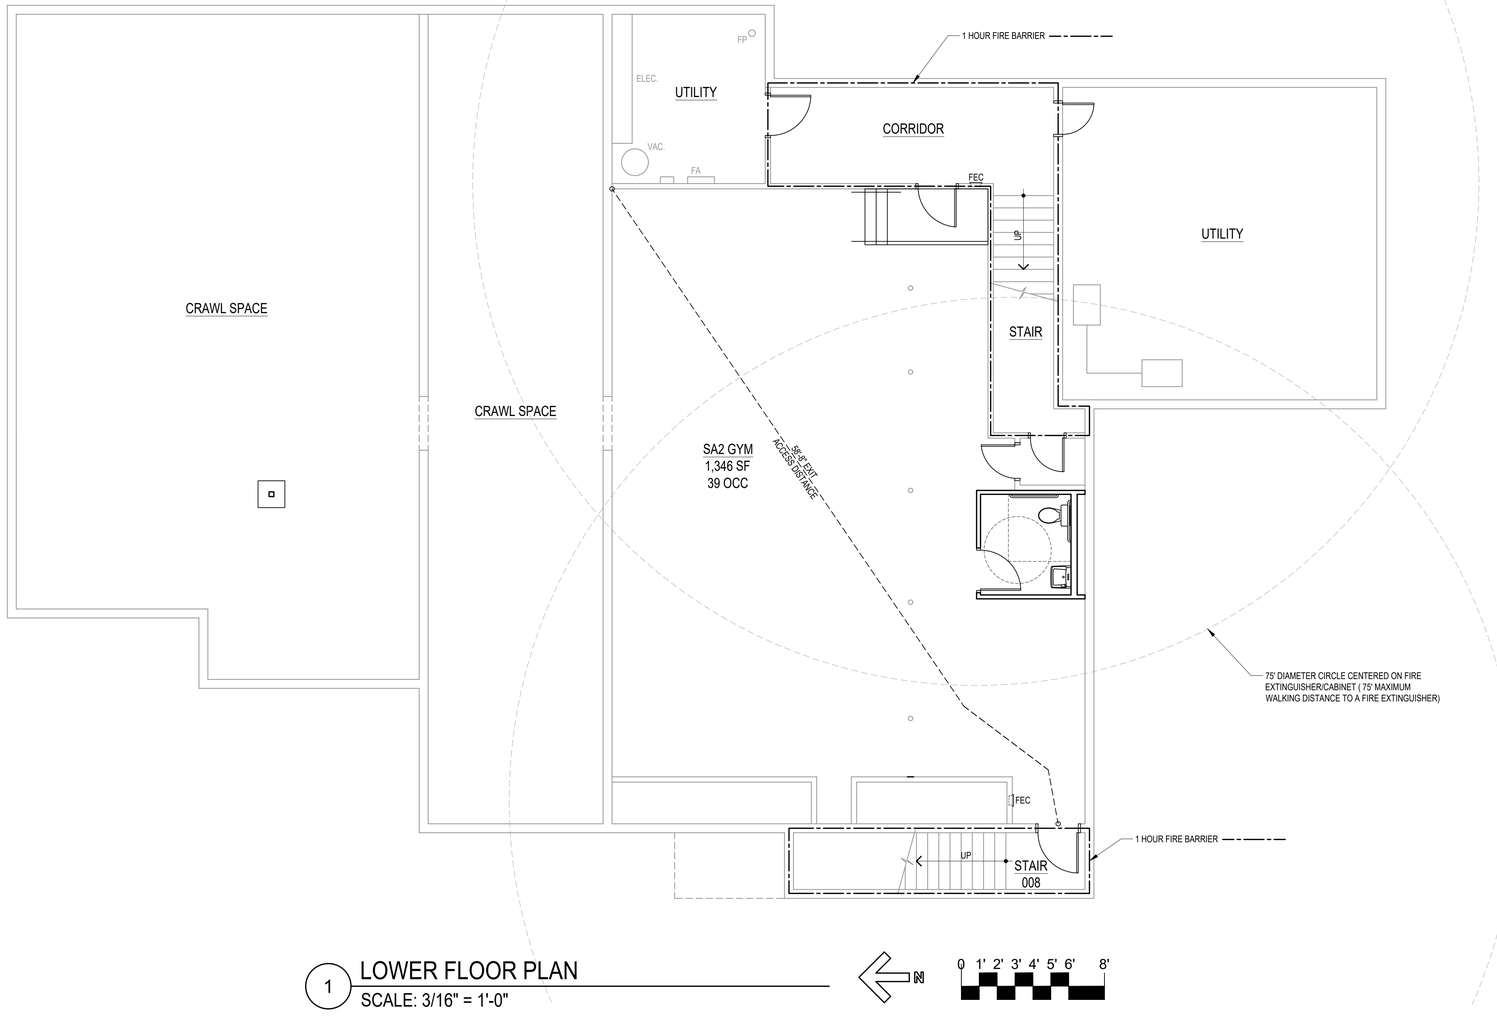

1 LOWER FLOOR PLAN
SCALE: 3/16" = 1'-0"

N

0 1' 2' 3' 4' 5' 6' 8'

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

RESIDENTIAL•COMMERCIAL•INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R MASON No. 3380
THE STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED. ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

DC1.0

CODE STUDY LOWER FLOOR PLAN

CODE STUDY:

- 2021 NEW HAMPSHIRE BUILDING CODE (IBC)
- 2021 NEW HAMPSHIRE EXISTING BUILDING CODE (IEBC)
- 2018 NEW HAMPSHIRE ENERGY CONSERVATION CODE (IECC)
- 2021 NEW HAMPSHIRE MECHANICAL CODE (IMC)
- 2021 NEW HAMPSHIRE PLUMBING CODE (IPC)
- 2023 NEW HAMPSHIRE ELECTRICAL CODE
- 2021 NEW HAMPSHIRE LIFE SAFETY CODE, NFPA 101
- 2021 UNIFORM FIRE CODE, NFPA 1
- 2010 ADA STANDARDS
- 2021 NEW HAMPSHIRE ACCESSIBILITY CODE

ALTERATIONS
IECC: LEVEL 3
NFPA 101: LEVEL 2
IBC: I-4 (INFANTS)
IBC: E (2.5 YEARS AND OLDER)
NFPA: DAYCARE

OCCUPANCY 302
OCCUPANCY CLASSIFICATION: E AND I-4

506.2

LOWER FLOOR	3,621 SF
FIRST FLOOR	6,281 SF
UPPER FLOOR	2,721 SF
TOTAL AREA	12,623 SF

MAXIMUM ALLOWABLE AREA: 27,000 SF

601
FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: 0 HR

602
CONSTRUCTION TYPE: V-B
NFPA 101: V

903.2.3
EXISTING PROJECT: 100% SPRINKLERED
RENOVATION: 100% SPRINKLER
EXISTING PROJECT: 100% FIRE ALARM
RENOVATION: 100% FIRE ALARM

1004.5

OCCUPANT LOAD LOWER FLOOR	39
OCCUPANT LOAD FIRST FLOOR	191
OCCUPANT LOAD SECOND FLOOR	34
TOTAL OCCUPANT LOAD	110

1006.2.1
LOWER FLOOR: 1 EXIT REQUIRED, 2 PROVIDED
FIRST FLOOR: 2 EXITS REQUIRED, 3 EXITS PROVIDED
SECOND FLOOR: 1 EXIT REQUIRED, 1 PROVIDED

1007.1.1, EXCEPTION 2.
EXITS SEPARATED BY NOT LESS THAN 1/3 DIAGONAL DISTANCE


1017.2
EXIT ACCESS TRAVEL DISTANCE: 200'

1020.2
CORRIDOR FIRE-RESISTANCE RATING: 0 HR

1020.3
MINIMUM CORRIDOR WIDTH 44"
CORRIDOR WIDTH PROVIDED 44"

DESIGN BUILD DESIGN
MECHANICAL
ELECTRICAL
PLUMBING
FIRE PROTECTION

FEC = FIRE EXTINGUISHER AND CABINET
FE = FIRE EXTINGUISHER

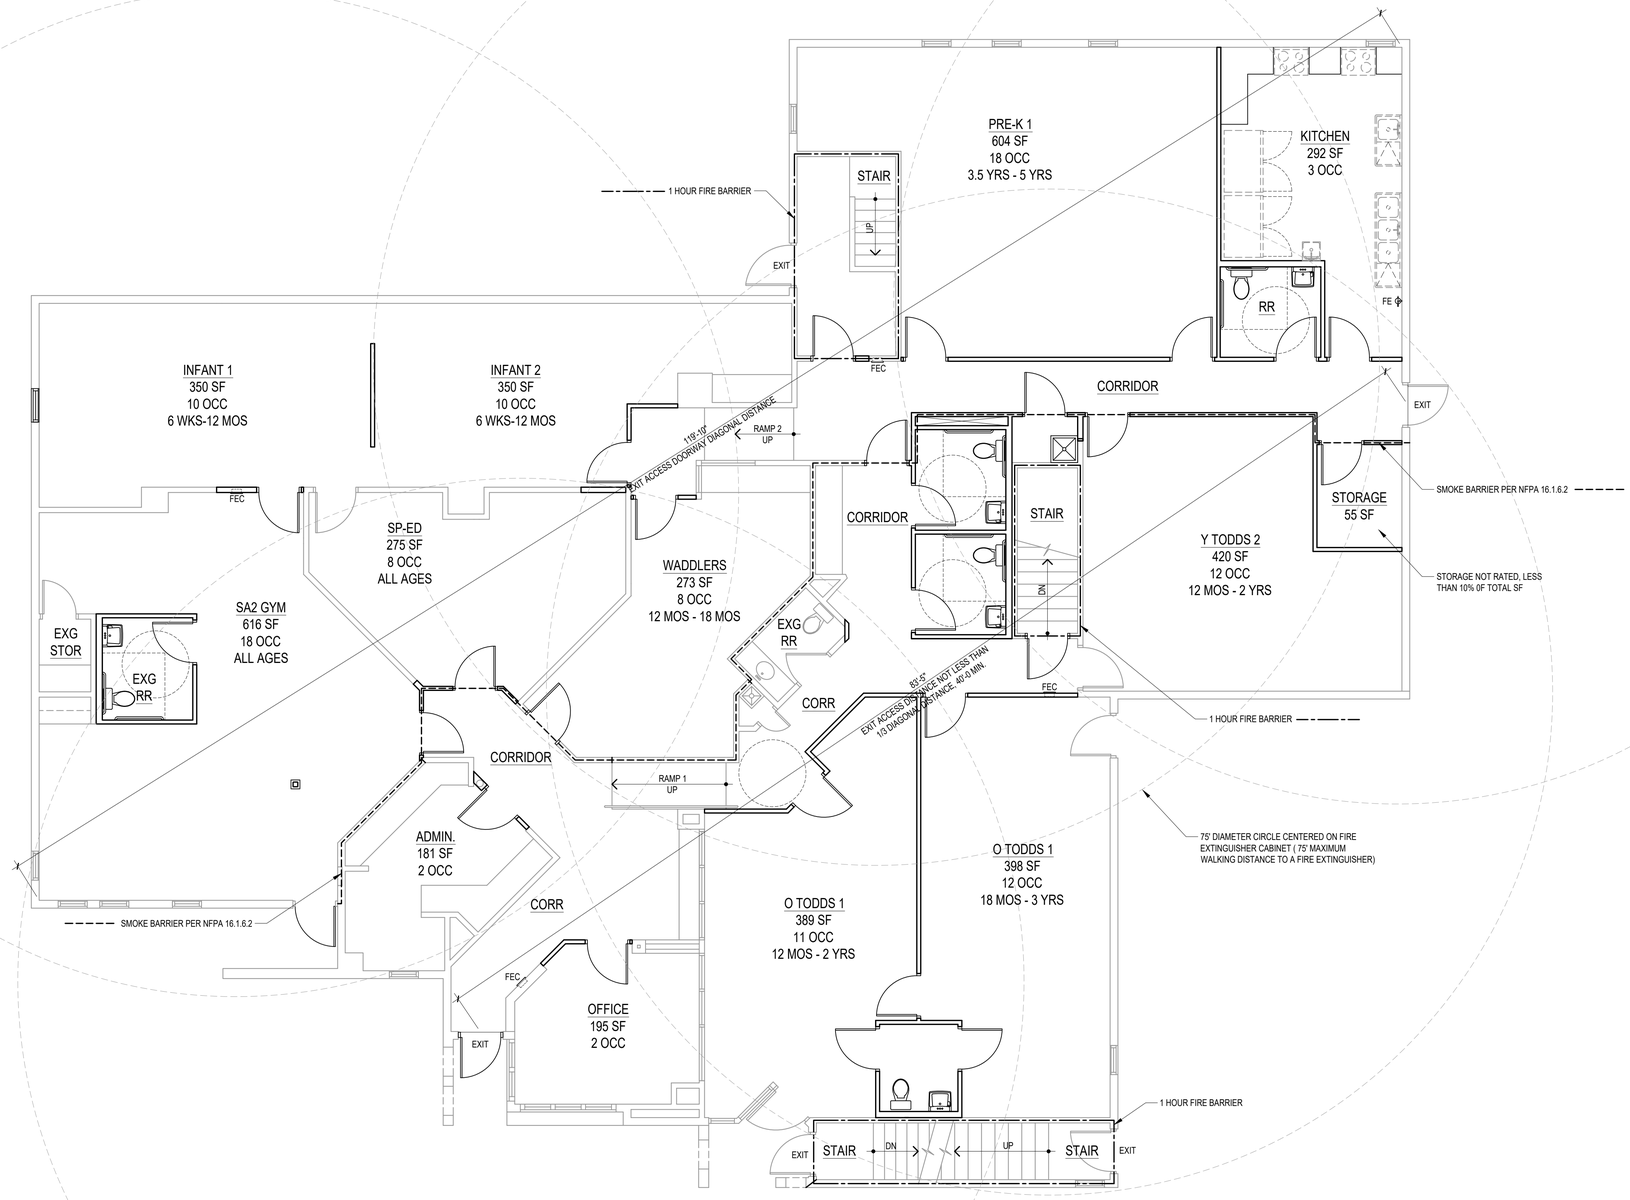

1 FIRST FLOOR PLAN
SCALE: 3/16" = 1'-0"

N

0 1' 2' 3' 4' 5' 6' 8'

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

RESIDENTIAL • COMMERCIAL • INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R. MASON
No. 3380
THE STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED, ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

DC1.1

CODE STUDY FIRST FLOOR PLAN

CODE STUDY:

- 2021 NEW HAMPSHIRE BUILDING CODE (IBC)
- 2021 NEW HAMPSHIRE EXISTING BUILDING CODE (IEBC)
- 2018 NEW HAMPSHIRE ENERGY CONSERVATION CODE (IECC)
- 2021 NEW HAMPSHIRE MECHANICAL CODE (IMC)
- 2021 NEW HAMPSHIRE PLUMBING CODE (IPC)
- 2023 NEW HAMPSHIRE ELECTRICAL CODE
- 2021 NEW HAMPSHIRE LIFE SAFETY CODE, NFPA 101
- 2021 UNIFORM FIRE CODE, NFPA 1
- 2010 ADA STANDARDS
- 2021 NEW HAMPSHIRE ACCESSIBILITY CODE

ALTERATIONS
IECC: LEVEL 3
NFPA 101: LEVEL 2
IBC: I-4 (INFANTS)
IBC: E (2.5 YEARS AND OLDER)
NFPA: DAYCARE

OCCUPANCY 302
OCCUPANCY CLASSIFICATION: E AND I-4

506.2

LOWER FLOOR	3,621 SF
FIRST FLOOR	6,281 SF
UPPER FLOOR	2,721 SF
TOTAL AREA	12,623 SF

MAXIMUM ALLOWABLE AREA: 27,000 SF

601
FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: 0 HR

602
CONSTRUCTION TYPE; V-B
NFPA 101: V

903.2.3
EXISTING PROJECT: 100% SPRINKLERED
RENOVATION: 100% SPRINKLER
EXISTING PROJECT: 100% FIRE ALARM
RENOVATION: 100% FIRE ALARM

1004.5

OCCUPANT LOAD LOWER FLOOR	39
OCCUPANT LOAD FIRST FLOOR	191
OCCUPANT LOAD SECOND FLOOR	34
TOTAL OCCUPANT LOAD	110

1006.2.1
LOWER FLOOR: 1 EXIT REQUIRED, 2 PROVIDED
FIRST FLOOR: 2 EXITS REQUIRED, 3 EXITS PROVIDED
SECOND FLOOR: 1 EXIT REQUIRED, 1 PROVIDED

1007.1.1, EXCEPTION 2.
EXITS SEPARATED BY NOT LESS THAN 1/3 DIAGONAL DISTANCE


1017.2
EXIT ACCESS TRAVEL DISTANCE: 200'

1020.2
CORRIDOR FIRE-RESISTANCE RATING: 0 HR

1020.3
MINIMUM CORRIDOR WIDTH 44"
CORRIDOR WIDTH PROVIDED 44"

DESIGN BUILD DESIGN
MECHANICAL
ELECTRICAL
PLUMBING
FIRE PROTECTION

FEC = FIRE EXTINGUISHER AND CABINET
FE = FIRE EXTINGUISHER

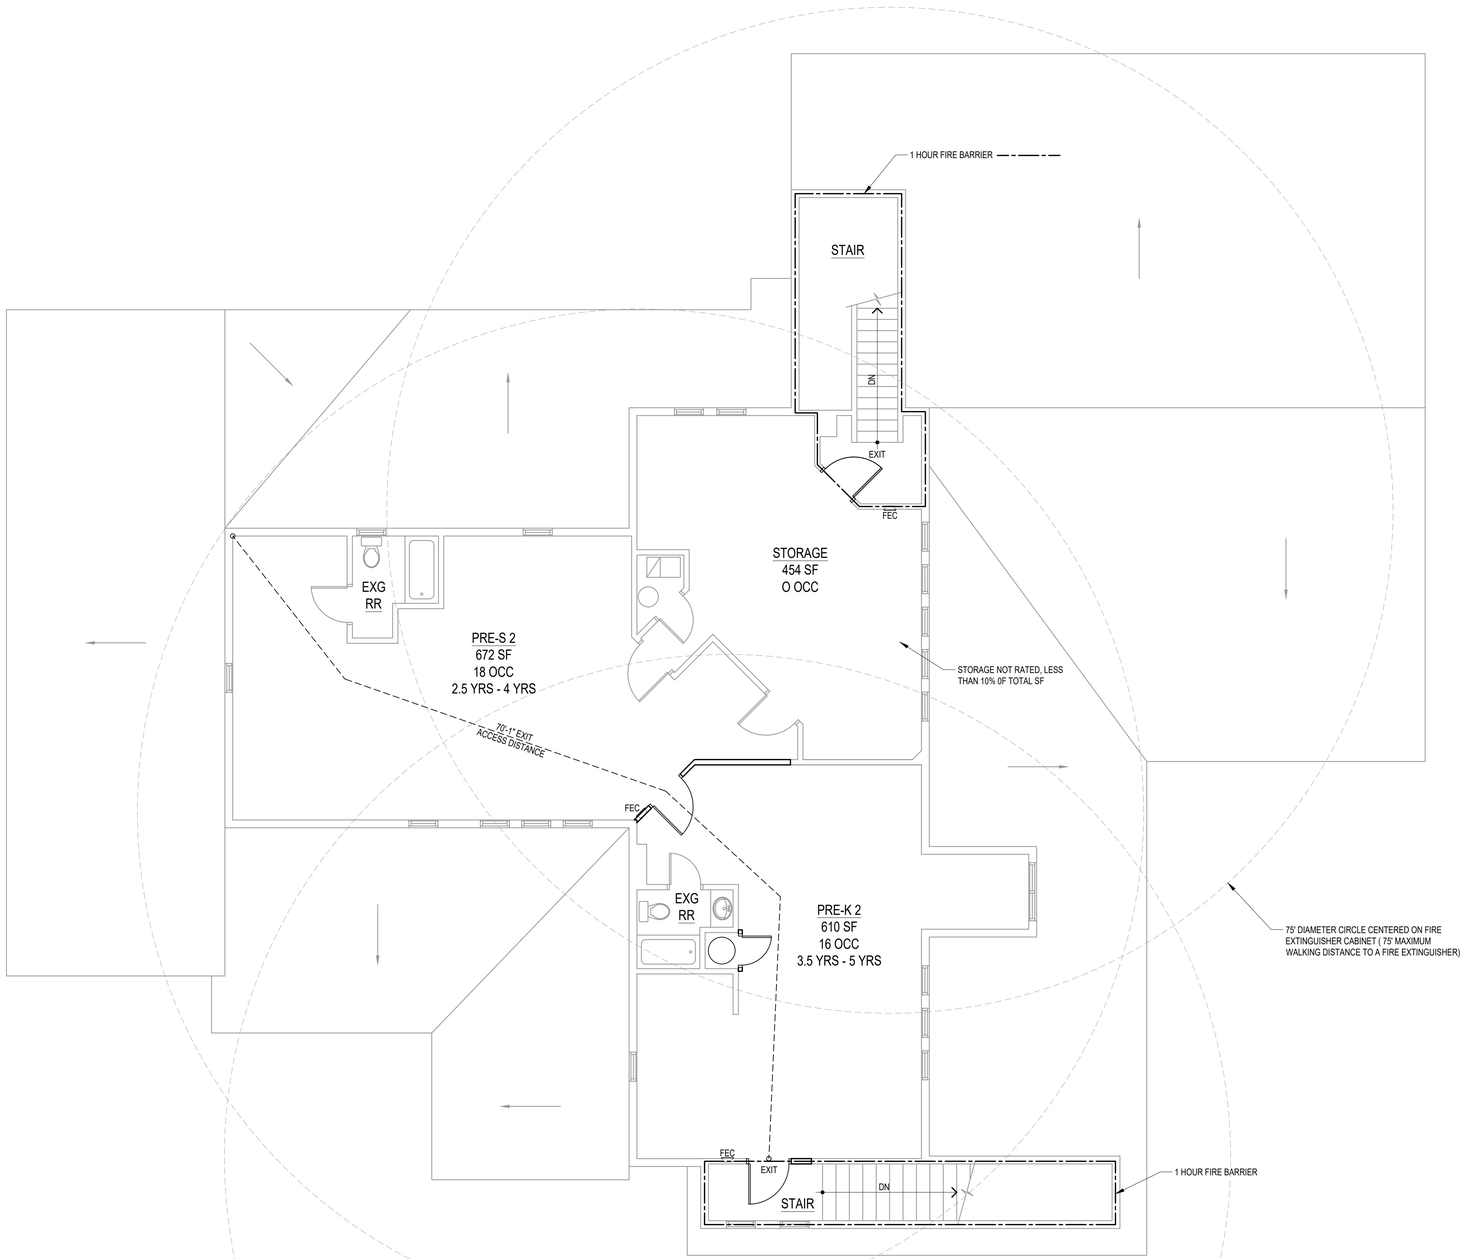

1 UPPER FLOOR PLAN
SCALE: 3/16" = 1'-0"

N

0 1' 2' 3' 4' 5' 6' 8'

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

RESIDENTIAL • COMMERCIAL • INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R. MASON
No. 3380
THE STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED. ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO.
2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

DC1.2

CODE STUDY SECOND FLOOR PLAN

WALL TYPE NOTES:


1. PROVIDE MOLD AND MOISTURE RESISTANT TYPE "X" GYPSUM BOARD AT RR AND KITCHEN WALLS.
2. SEAL ALL PENETRATIONS AT SMOKE BARRIERS WITH APPROVED MATERIAL TO LIMIT THE PASSAGE OF SMOKE.
3. SEAL ALL PENETRATIONS AT FIRES BARRIERS WITH APPROVED FIRESTOPPING MATERIAL.

WALL TYPE LEGEND

1. 2x4 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.
2. 2x6 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.
3. SMOKE BARRIER
   2x4 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE. TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.
4. SMOKE BARRIER
   EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE.
   JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.
5. 1HR FIRE BARRIER
   EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.
6. 1HR FIRE BARRIER
   EXISTING 8" CMU WALL
7. 1HR FIRE BARRIER
   EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON INTERIOR SIDE.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK OR CEILING ABOVE.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

KEYNOTES: "X"

1. STAIR LANDING
2. HANDRAILS: 1 1/2" OUTSIDE DIAMETER.
3. STAIRS: 10" TREADS (1" NOSING), 3 RISERS AT 7" MAX.
4. FOOTING: 24"x24"x12" WITH #4 BAR AT 12" O.C. EACH WAY.
5. COLUMN: 4x4 HSS.

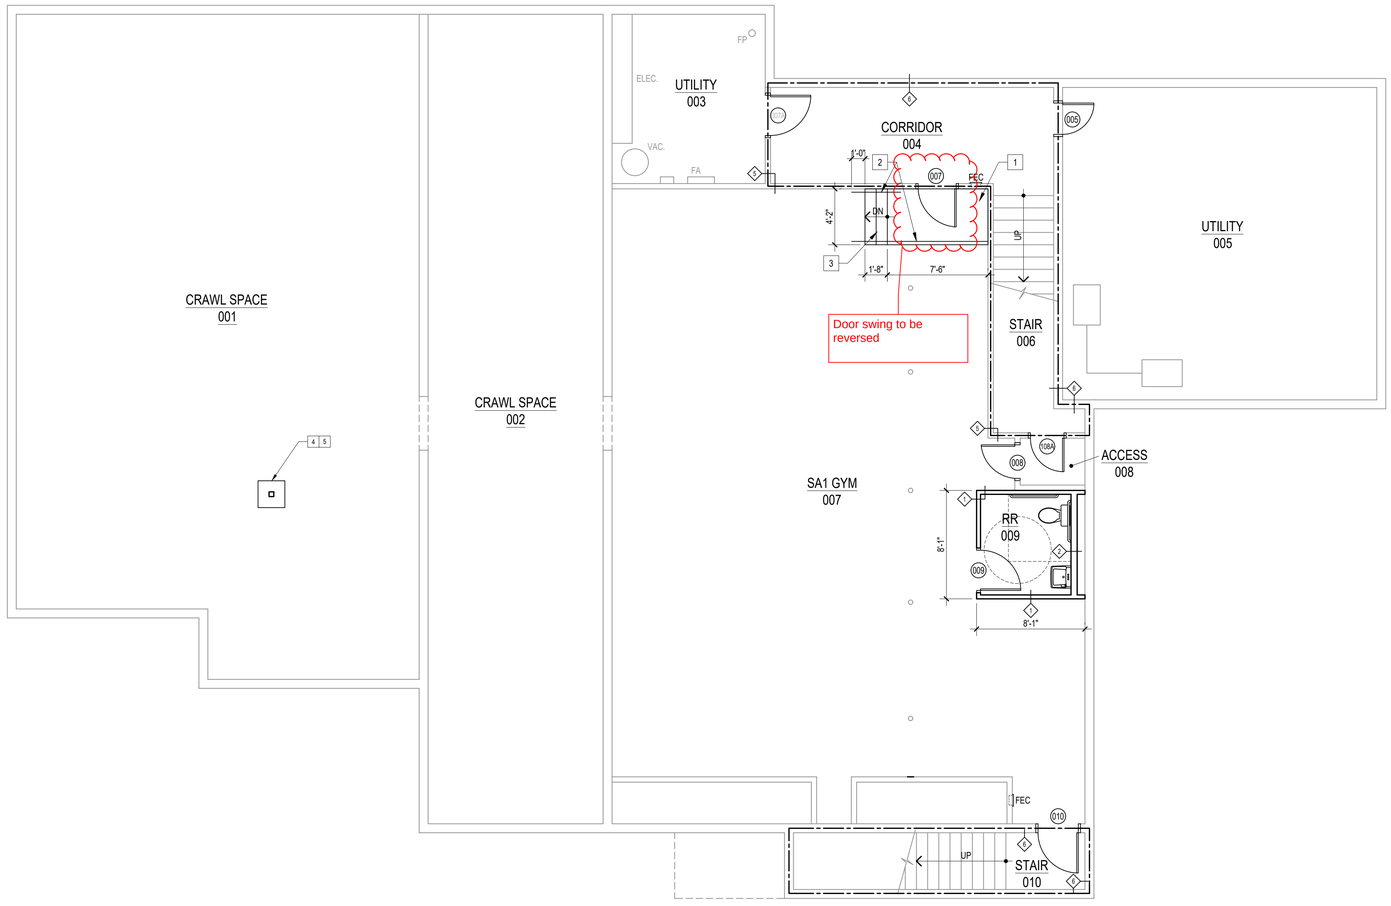

1 LOWER FLOOR PLAN
SCALE: 3/16" = 1'-0"

N

0 1' 2' 3' 4' 5' 6' 8'

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

RESIDENTIAL • COMMERCIAL • INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R. MASON
No. 3380
THE STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED. ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

A1.0

LOWER FLOOR PLAN

WALL TYPE NOTES:

1. PROVIDE MOLD AND MOISTURE RESISTANT TYPE "X" GYPSUM BOARD AT RR AND KITCHEN WALLS.
2. SEAL ALL PENETRATIONS AT SMOKE BARRIERS WITH APPROVED MATERIAL TO LIMIT THE PASSAGE OF SMOKE.
3. SEAL ALL PENETRATIONS AT FIRES BARRIERS WITH APPROVED FIRESTOPPING MATERIAL.

WALL TYPE LEGEND

1. 2x4 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

2. 2x6 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

3. SMOKE BARRIER
   2x4 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE. TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

4. SMOKE BARRIER
   EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE.
   JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

5. 1HR FIRE BARRIER
   EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

6. 1HR FIRE BARRIER
   EXISTING 8" CMU WALL


7. 1HR FIRE BARRIER
   EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON INTERIOR SIDE.
   EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK OR CEILING ABOVE.
   TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
   PAINT - PRIME AND 2 COAT FINISH.

FEC
FIRE EXTINGUISHER AND SEMI-RECESSED CABINET, 4" MAX PROJECTION FROM WALL.

FE
FIRE EXTINGUISHER, WALL BRACKET MOUNTED

KEYNOTES: "X"

1. COLUMN: 4x4 HSS WITH BASE PLATE CONNECTION ABOVE FLOOR.
2. COLUMN PADDING.
3. EXTEND FIRE BARRIER TO INSIDE FACE OF EXTERIOR SHEATHING.
4. KITCHEN EQUIPMENT BY OWNER.
5. WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS. TAPE & JOINT COMPOUND - LEVEL 4 FINISH, PAINT - PRIME AND 2 COAT FINISH. TOP OF WALL 6' AFF, VERIFY WITH TENANT.

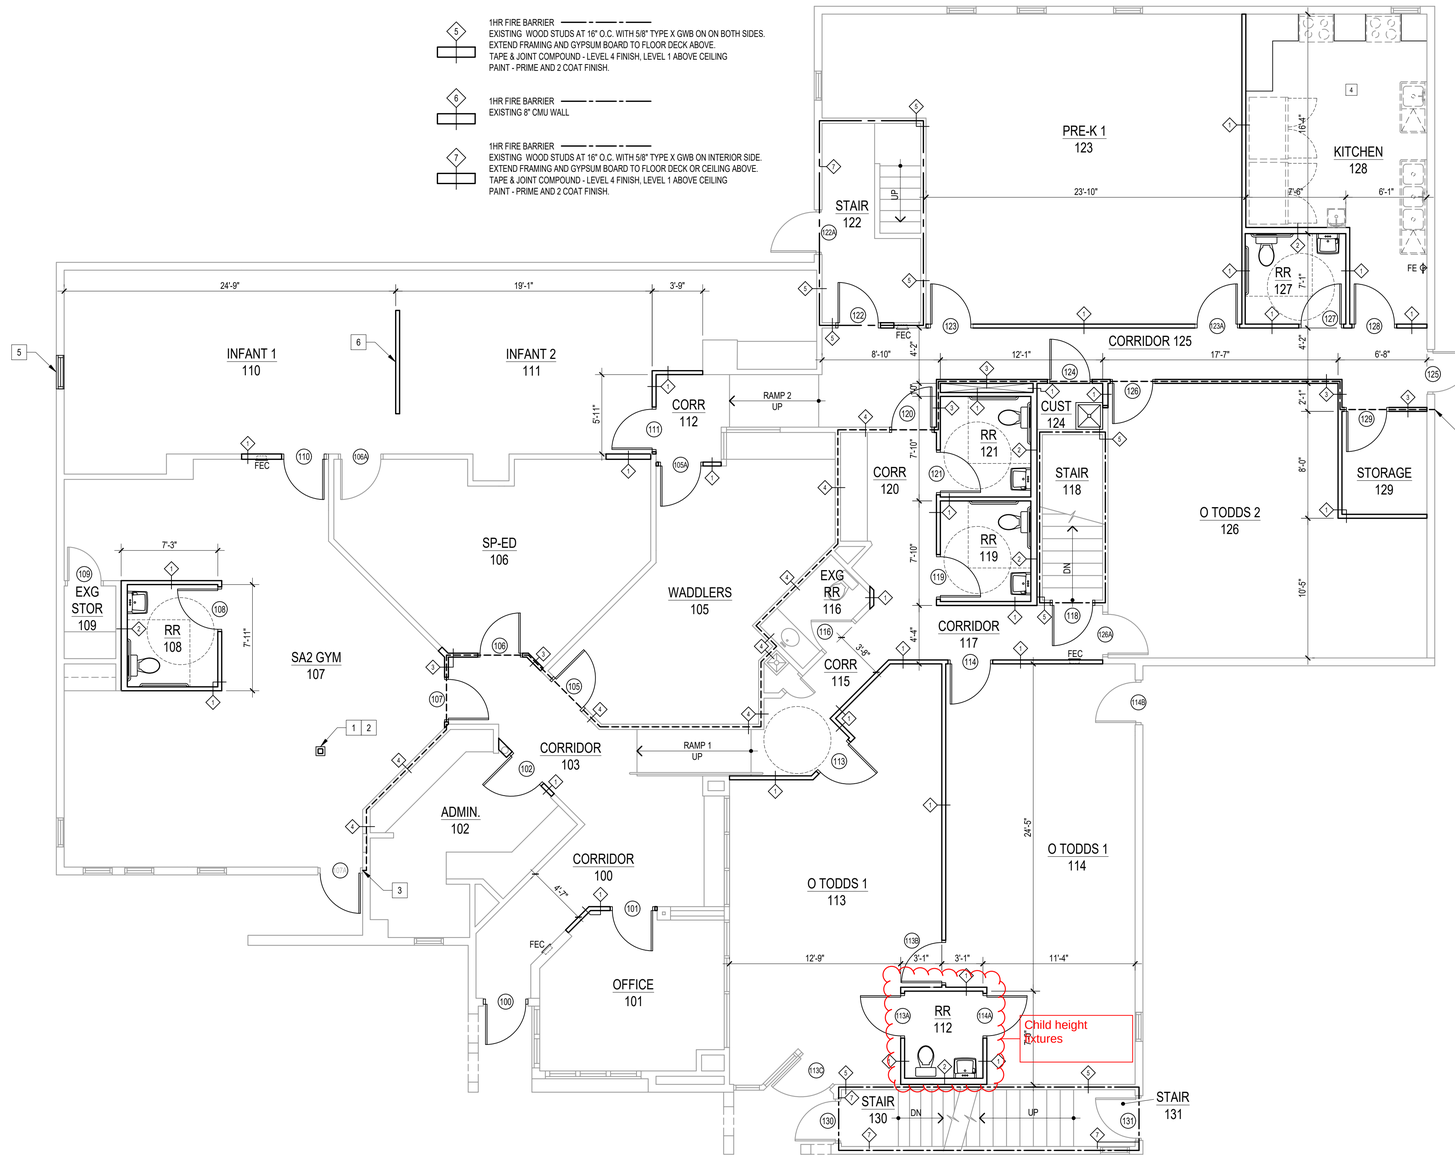

1 FIRST FLOOR PLAN
SCALE: 3/16" = 1'-0"

0 1' 2' 3' 4' 5' 6' 8'

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

ACS
RESIDENTIAL • COMMERCIAL • INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R. MASON
No. 3380
STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED. ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

A1.1

FIRST FLOOR PLAN

WALL TYPE NOTES:

1. PROVIDE MOLD AND MOISTURE RESISTANT TYPE "X" GYPSUM BOARD AT RR AND KITCHEN WALLS.
2. SEAL ALL PENETRATIONS AT SMOKE BARRIERS WITH APPROVED MATERIAL TO LIMIT THE PASSAGE OF SMOKE.
3. SEAL ALL PENETRATIONS AT FIRES BARRIERS WITH APPROVED FIRESTOPPING MATERIAL.

WALL TYPE LEGEND

1 — 2x4 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
PAINT - PRIME AND 2 COAT FINISH.

2 — 2x6 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
PAINT - PRIME AND 2 COAT FINISH.

3 — SMOKE BARRIER
2x4 WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE. TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
PAINT - PRIME AND 2 COAT FINISH.

4 — SMOKE BARRIER
EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES WITH 3 1/2" SOUND ATTENUATION BATTS.
EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE.
JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
PAINT - PRIME AND 2 COAT FINISH.

5 — 1HR FIRE BARRIER
EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON ON BOTH SIDES.
EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK ABOVE.
TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
PAINT - PRIME AND 2 COAT FINISH.

6 — 1HR FIRE BARRIER
EXISTING 8" CMU WALL


7 — 1HR FIRE BARRIER
EXISTING WOOD STUDS AT 16" O.C. WITH 5/8" TYPE X GWB ON INTERIOR SIDE.
EXTEND FRAMING AND GYPSUM BOARD TO FLOOR DECK OR CEILING ABOVE.
TAPE & JOINT COMPOUND - LEVEL 4 FINISH, LEVEL 1 ABOVE CEILING
PAINT - PRIME AND 2 COAT FINISH.

FEC
FIRE EXTINGUISHER AND SEMI-RECESSED CABINET, 4" MAX PROJECTION FROM WALL.

FE
FIRE EXTINGUISHER, WALL BRACKET MOUNTED

KEYNOTES: "X"

1. RELOCATED EXISTING WATER HEATER.
2. EXTEND FIRE BARRIER TO ROOF DECK ABOVE.

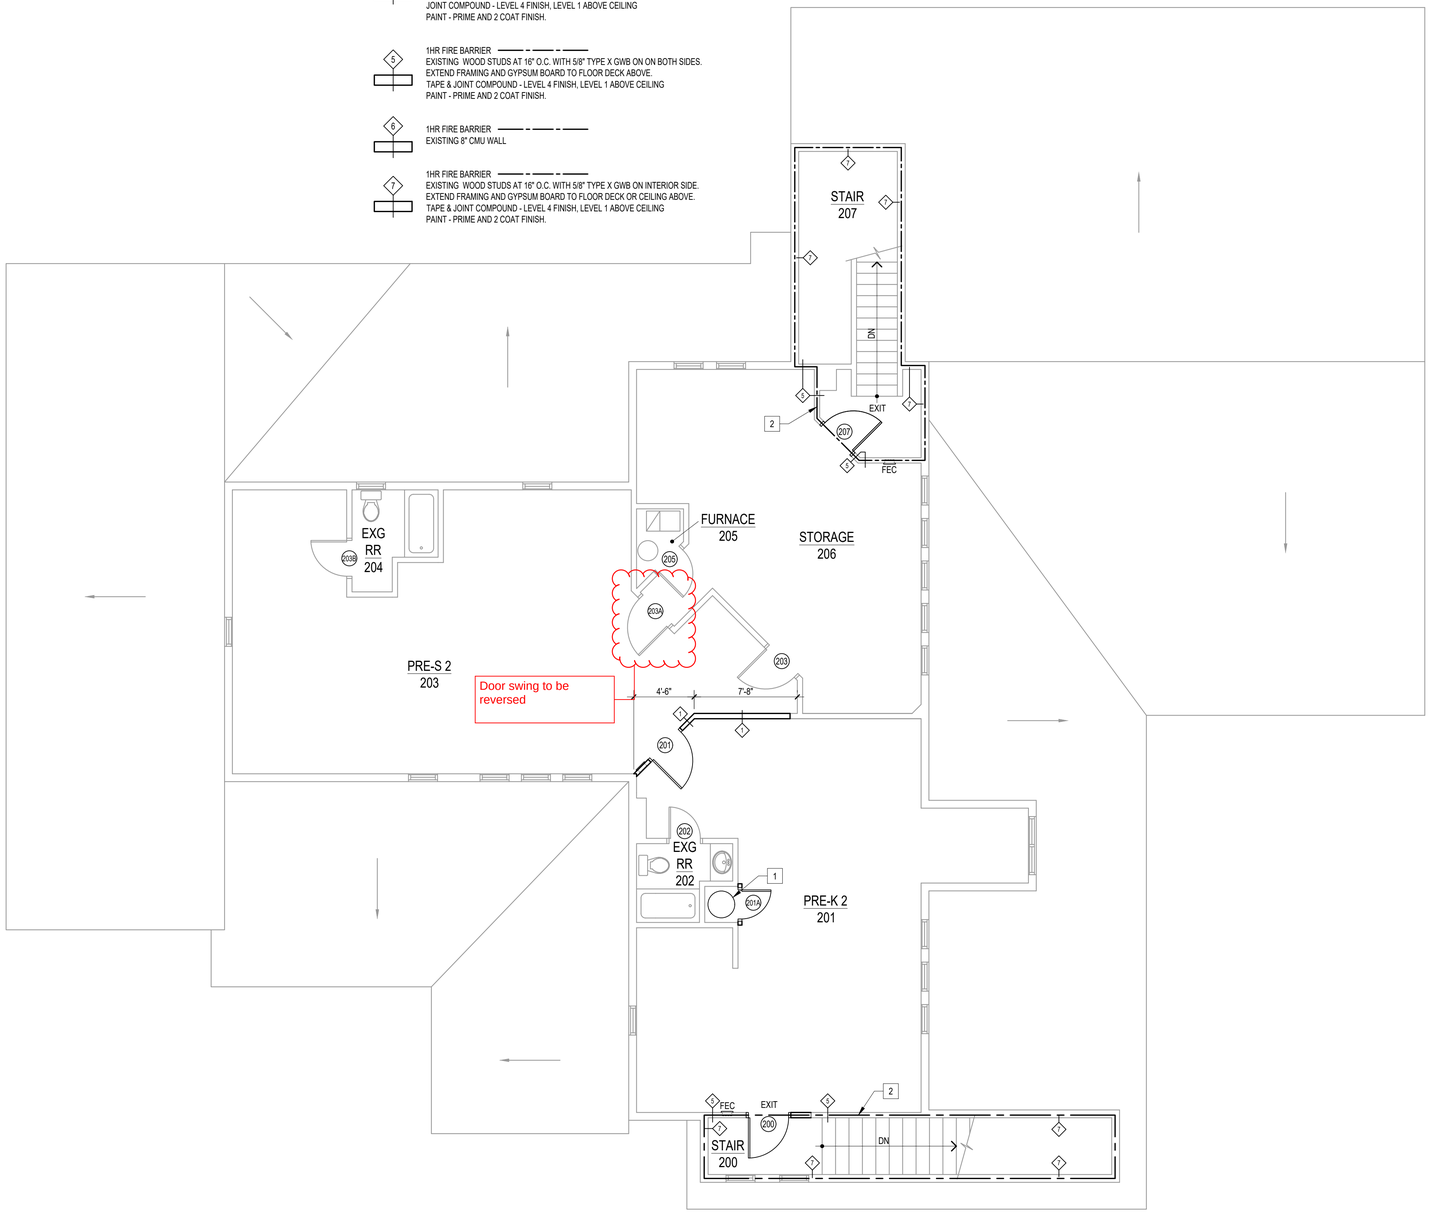

1 UPPER FLOOR PLAN
SCALE: 3/16" = 1'-0"

N

0 1' 2' 3' 4' 5' 6' 8'

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

RESIDENTIAL • COMMERCIAL • INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R. MASON
No. 3380
STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED, ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

A1.2

SECOND FLOOR PLAN

DOOR AND FRAME SCHEDULE

MARK	DOOR SIZE WD	DOOR SIZE HGT	DOOR SIZE THK	DOOR MATL	DOOR GLAZING	DOOR TYPE	DOOR RATING	DOOR U FACTOR	FRAME MAT'L	LEVER SET ENTRANCE LOCK	LEVER SET CLASSROOM	LEVER SET DUMMY	LEVER SET STOREROOM LOCK	LEVER SET PRIVACY LOCK	LEVER SET PASSAGE	HINGES	DEADBOLT	DOOR CLOSER ALL S	PANIC BAR DEVICE (PANIC)	CLOSER	THRESHOLD (ACCESSIBLE)	WEATHER STRIPPING	KICK PLATE	WALL STOP	OVERHEAD STOP	NOTES
005	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
007	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
007A	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
008	2'-8"	7'-0"	1 3/4"	WOOD		1			WOOD																	
009	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
010	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
100	3'-0"	7'-0"	1 3/4"	HM		1		0.37	HM												X	X				GALVANIZED STEEL WITH INSULATED CORE
101	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
102	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD							X	X	X								SMOKE BARRIER DOOR
105	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD							X	X	X								SMOKE BARRIER DOOR
105A	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
106	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD							X	X	X								SMOKE BARRIER DOOR
106A	EXG	EXG	EXG	EXG					EXG																	
107	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD							X	X	X								SMOKE BARRIER DOOR
107A	3'-0"	7'-0"	1 3/4"	HM		1		0.37	HM												X	X				GALVANIZED STEEL WITH INSULATED CORE
108	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
108A	2'-6"	7'-0"	1 3/4"	WOOD		1			WOOD																	
109	EXG	EXG	EXG	EXG					EXG																	
110	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
111	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
112	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
113	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
113A	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
113B	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
113C	EXG	EXG	EXG	EXG					EXG																	
114	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
114A	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
114B	EXG	EXG	EXG	EXG					EXG																	
116	EXG	EXG	EXG	EXG					EXG																	
118	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
119	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
120	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
121	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
122	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
122A	EXG	EXG	EXG	EXG					EXG							X	X	X								
123	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
123A	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
124	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD																	SMOKE BARRIER DOOR
125	EXG	EXG	EXG	EXG					EXG							X	X	X								
126	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD																	SMOKE BARRIER DOOR
126A	EXG	EXG	EXG	EXG					EXG																	
127	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
128	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
129	3'-0"	7'-0"	1 3/4"	WOOD		1	20 MIN.		WOOD							X	X	X								SMOKE BARRIER DOOR
130	EXG	EXG	EXG	EXG					EXG																	
131	EXG	EXG	EXG	EXG					EXG																	
200	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								FIRE BARRIER DOOR
201	3'-0"	7'-0"	1 3/4"	WOOD		1			WOOD																	
201A	2'-2"	7'-0"	1 3/4"	WOOD		1			WOOD																	
202	EXG	EXG	EXG	EXG					EXG																	
203	EXG	EXG	EXG	EXG					EXG																	
203A	EXG	EXG	EXG	EXG					EXG																	
203B	EXG	EXG	EXG	EXG					EXG																	
205	EXG	EXG	EXG	EXG					EXG																	
207	3'-0"	7'-0"	1 3/4"	HM		1	60 MIN.		HM							X	X	X								

DOOR NOTES:

1. DOORS & FRAMES MUST MATCH THE ACOUSTICAL, FIRE CODE, AND/OR SECURITY QUALITIES OF THE SURROUNDING WALLS.
2. PROVIDE DOOR SUBMITTAL FOR ARCHITECT REVIEW PRIOR TO ORDER.
3. DIMENSIONS & LOCATIONS OF DOORS & HARDWARE MUST COMPLY WITH ALL APPLICABLE ACCESSIBILITY REQUIREMENTS.
4. ALL GLAZING MUST COMPLY WITH BUILDING CODES.
5. CONTRACTOR MUST V.I.F. ALL DOOR SIZES AND JAMB DEPTHS WITH MANUFACTURE AND EXISTING CONDITIONS.
6. ALL THRESHOLDS FOR BE ACCESSIBLE TYPE.
7. PROVIDE FIRE RATED HARDWARE AT FIRE RATED DOORS AND FRAMES.
8. SMOKE BARRIER DOORS SHALL COMPLY WITH NFPA 252 OR UL 10C WITHOUT HOSE STREAM TEST.

THIS DRAWING SCALE IS BASED ON PRINTING AT 24X36

ACS

RESIDENTIAL•COMMERCIAL•INSTITUTIONAL

PROJECT TEAM

ARCHITECT
ARCHITECTURAL CONSULTING SERVICES, LLC
CONTACT: JAY R. MASON, AIA, LEED AP
4 WASHINGTON RD.
RYE, NH 03870
TEL: (603) 769-3033
EMAIL: JAY@ACSLOWELL.COM

STRUCTURAL ENGINEER
WEBB STRUCTURAL SERVICES
CONTACT: VINCENT STRANGES
670 MAIN STREET
READING, MA 01867
TEL: (781) 779-1330, EXT. 106
EMAIL: VINCE@WEBBSS.NET

STAMP

LICENSED ARCHITECT
JAY R. MASON
No. 3380
STATE OF NEW HAMPSHIRE

THIS DRAWING IS A LEGAL INSTRUMENT OF DESIGN SERVICES AND SHALL REMAIN THE SOLE PROPERTY OF ARCHITECTURAL CONSULTING SERVICES LLC AND MAY NOT BE REPRODUCED, ALTERED, OR COPIED IN WHOLE OR PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF IT MAY BE USED ONLY FOR THE ORIGINAL PURPOSE INTENDED. ARCHITECTURAL CONSULTING SERVICES LLC
© 2026, ALL RIGHTS RESERVED

OWNER

DAYCARE
RENOVATION
235 DANIEL WEBSTER HIGHWAY
MERRIMACH, NH 03054

MARK	DATE	DESCRIPTION

STATUS: CONSTRUCTION DOCUMENTS

PROJECT NO. 2611

CAD DWG FILE:	2611 CD'S.DWG
DRAWN LAST:	06/09/2026
DRAWN BY:	MK
CHK'D BY:	JM

SHEET TITLE

A9.0

SCHEDULES